
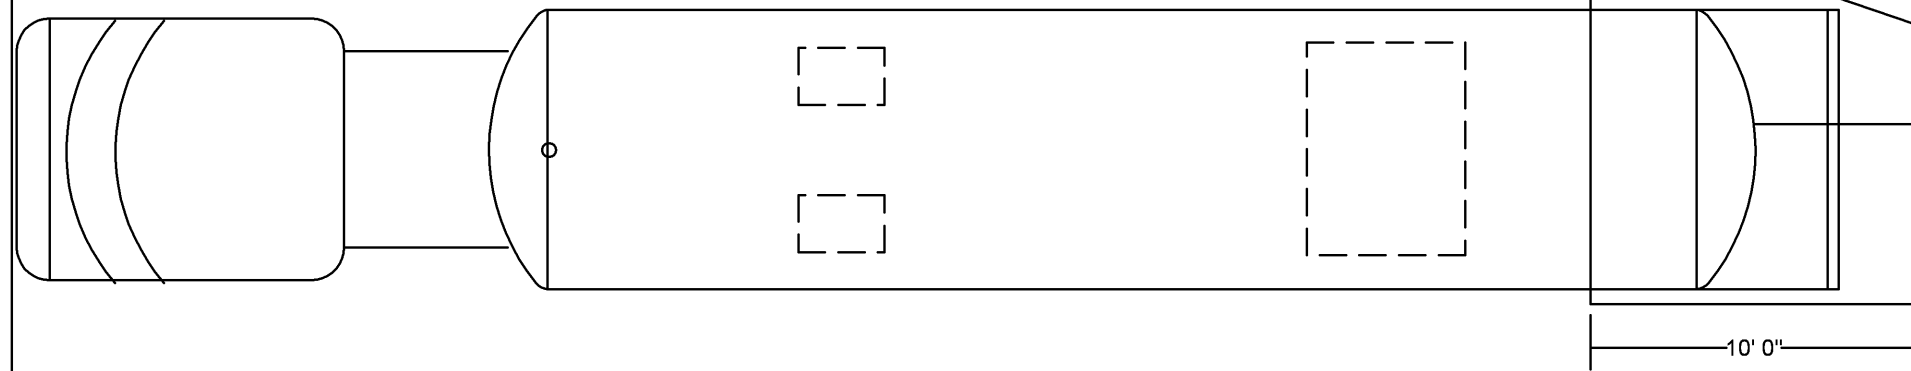


GENERAL NOTES:

1. DETERMINE EXACT LOCATION OF ALL EXISTING UNDERGROUNDS BEFORE BEGINNING EXCAVATION.
2. TURNING RADIUS OF TRUCK IS APPROXIMATELY 50'.
3. PROTECT SYSTEM WITH PIPE POSTS IF SUBJECT TO VEHICULAR TRAFFIC. (SEE FOUNDATION DETAIL D)
4. OXYGEN SYSTEMS TO BE SITED PER NFPA 50 "BULK OXYGEN SYSTEMS AT CONSUMER SITES", LATEST EDITION, OR LOCAL CODES, WHICHEVER IS MORE STRINGENT.
5. SEE FOUNDATION DRAWING FOR SECTION DETAILS.
6. TANK PAD HAS A RANGE OF TANK SIZE FROM 500 TO 1500 GALLONS.

CONFIDENTIAL
 THIS DRAWING IS THE PROPERTY OF AIR PRODUCTS AND CHEMICALS INC. AND MUST BE ACCOUNTED FOR AND RETURNED TO THE COMPANY. INFORMATION HEREON IS CONFIDENTIAL AND MUST NOT BE COPIED, REPRODUCED, DUPLICATED, DISCLOSED TO OTHERS IN WHOLE OR IN PART, SENT OUTSIDE THE COMPANY WITHOUT PROPER AUTHORIZATION, OR USED OTHER THAN FOR THE INTENDED PURPOSE FOR WHICH IT IS DISCLOSED.

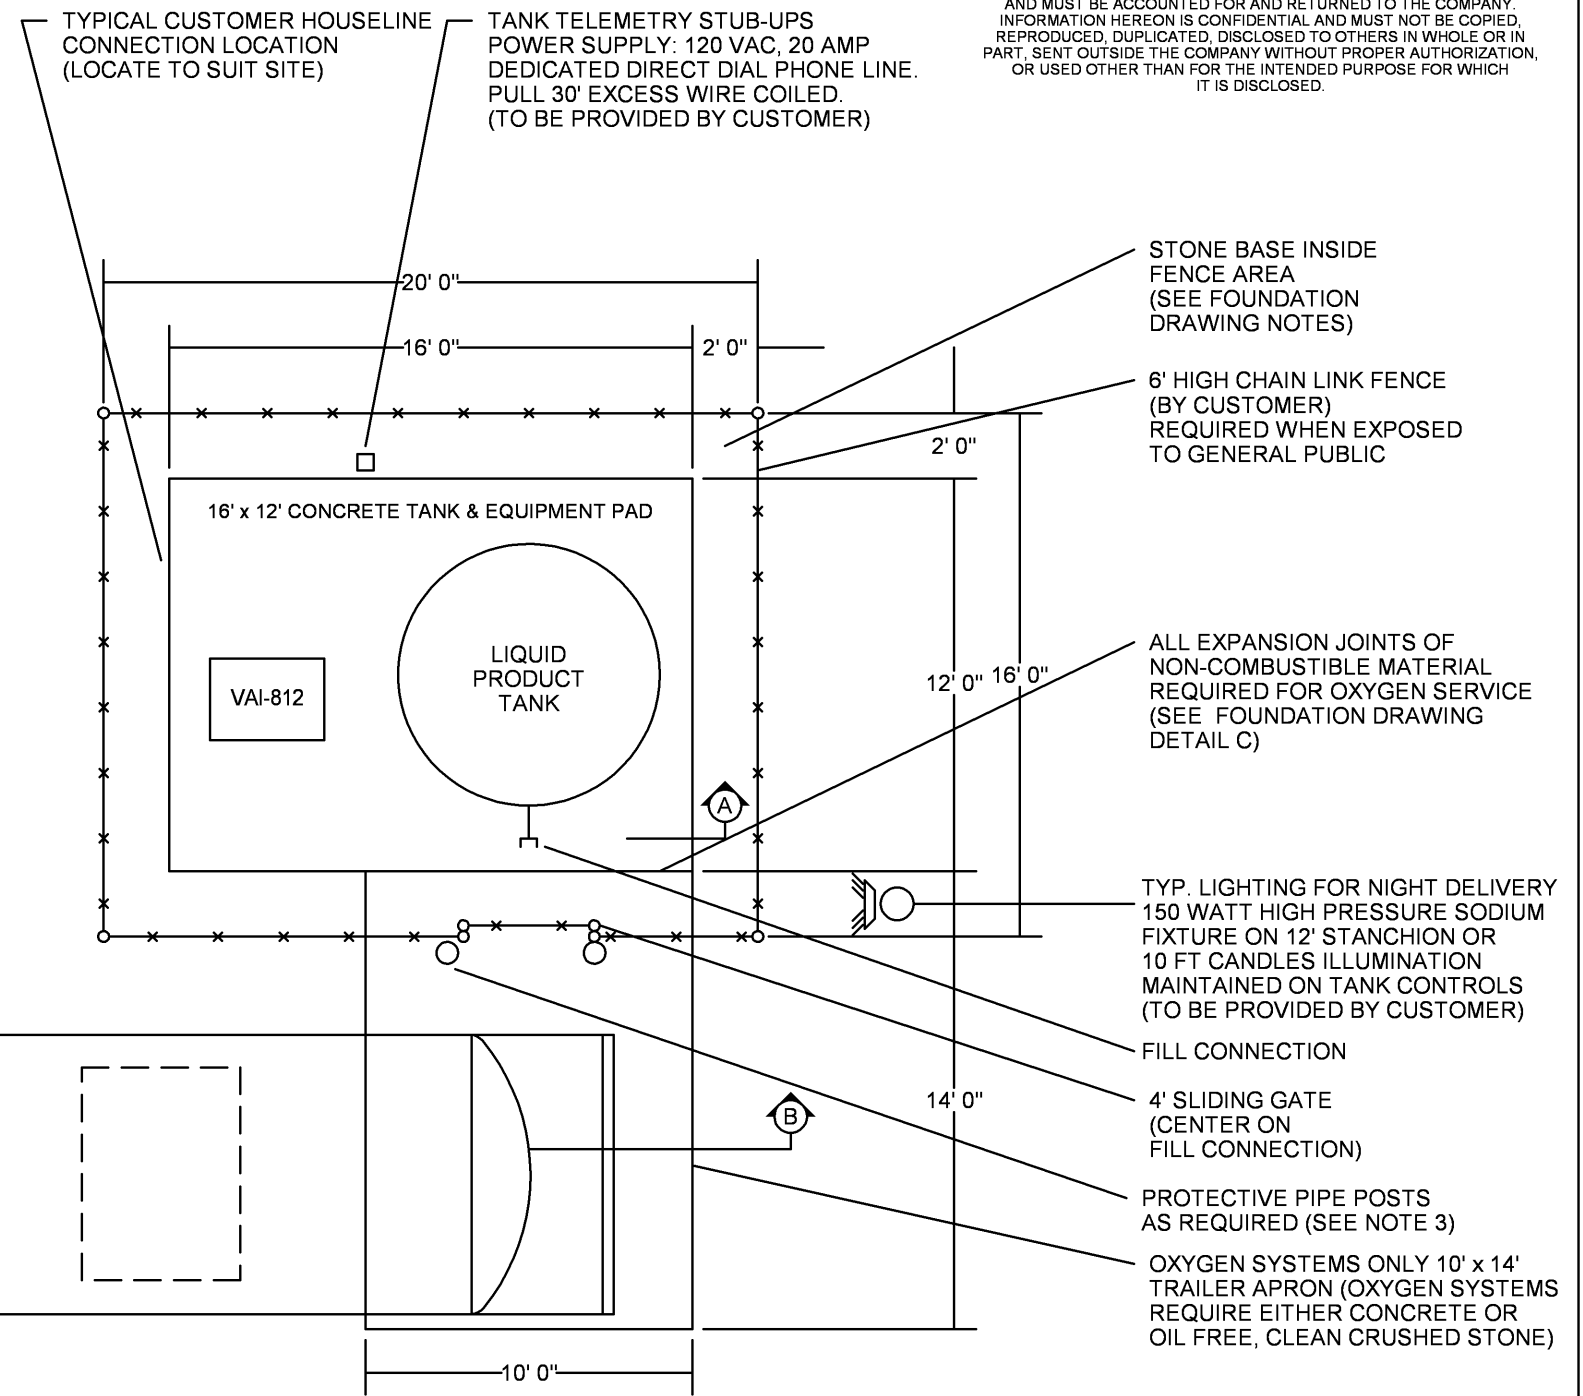

NOT FOR CONSTRUCTION

NOT FOR CONSTRUCTION										
REV.	REVISION DESCRIPTION	DATE	BY	OPERATIONS	SAFETY	DESIGN	ENG.	APPD.		
DRAWN				TITLE			AIR PRODUCTS			
OPERATIONS				STANDARD T-2 EQUIPMENT LAYOUT FOR LOX/LIN/LAR TANKS & EQUIPMENT			REF. NO.			
SAFETY				FILE:	DWG No.:			B	REV.	
DESIGN				LATM.CAD	BA#8L.CAD				0	
ENGINEER				SCALE	WT.			SHEET	1 OF 1	
APPD.				NONE						